

PC-22D ValvApp™ Worksheet



This worksheet is intended for the configuration of ValvApps™ used in the VC-22D Valve Controller. From the information provided below, Cla-Val will determine whether a standard ValvApp™ should be used or if a custom ValvApp™ is required. Additionally, this worksheet acts as a check list during commissioning to verify all parameters have been correctly configured in the VC-22D Valve Controller. Once this worksheet is completed, please return to your Cla-Val representative for approval. If a custom ValvApp is required and approved, a custom wiring diagram and ValvApp™ will be created and emailed to you. Please verify all *Required fields have been filled out prior to submittal.

Information	Reset Form	Configuration: PC-22D Modulating
*Project Name <input type="text" value="N/A"/>	*Today's Date <input type="text"/>	
*Cla-Val Representative <input type="text" value="N/A"/>	Project Completion Date <input type="text"/>	
Control Valve Model Number (if known) <input type="text" value="131"/>	Customer Approval Signature <input type="text"/>	

Valve Regulation (If more than 2 PID's are required, specify in logic on page 2)

<input checked="" type="checkbox"/> PID 1 - Valve Regulation	*Solenoid Config <input type="text" value="NO / NC (P.F. Close)"/>	<input type="checkbox"/> PID 2 - Valve Regulation	PID Selection Mode <input type="text"/>
*Control Type <input type="text" value="Other"/>	*Signal Loss <input type="text" value="Close Valve"/>	Control Type <input type="text"/>	Signal Loss <input type="text"/>
Deadband (+/-) <input type="text"/>	Ramping <input type="text"/>	Deadband (+/-) <input type="text"/>	Ramping <input type="text"/>

DP Metering (133 Valve)

<input type="checkbox"/> DP Metering	Pressure Measurement <input checked="" type="radio"/> P1+P2 <input type="radio"/> DPT	Output <input type="text"/>
Size <input type="text"/>	Body Style <input type="text"/>	Seat <input type="text"/>
Units <input type="text"/>	Output Scaling <input type="text"/>	

Totalizer

<input type="checkbox"/> Totalizer	Reset <input type="text"/>	Units <input type="text"/>	Output <input type="text"/>	Output Scaling <input type="text"/>
------------------------------------	----------------------------	----------------------------	-----------------------------	-------------------------------------

Analog Inputs (4-20mA) 6 Available

<input checked="" type="checkbox"/> *Analog Input #1 (Typically reserved for control setpoint signal)	Scaling <input type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Flow SP"/> Units <input type="text" value="gpm"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="2000"/> Decimal <input type="text" value="0"/>
<input checked="" type="checkbox"/> *Analog Input #2 (Typically reserved for control feedback signal)	Scaling <input checked="" type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Flow Feedback"/> Units <input type="text" value="gpm"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="2000"/> Decimal <input type="text" value="0"/>
<input checked="" type="checkbox"/> Analog Input #3	Scaling <input type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Position SP"/> Units <input type="text" value="%"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="100"/> Decimal <input type="text" value="0.0"/>
<input checked="" type="checkbox"/> Analog Input #4	Scaling <input checked="" type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Position Feedback"/> Units <input type="text" value="%"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="100"/> Decimal <input type="text" value="0.0"/>
<input checked="" type="checkbox"/> Analog Input #5	Scaling <input type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Sustaining SP"/> Units <input type="text" value="psi"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="290"/> Decimal <input type="text" value="0.0"/>
<input checked="" type="checkbox"/> Analog Input #6	Scaling <input checked="" type="checkbox"/> Signal Powered by Controller
Name <input type="text" value="Upstream Pressure"/> Units <input type="text" value="psi"/>	4mA = <input type="text" value="0"/> 20mA = <input type="text" value="290"/> Decimal <input type="text" value="0.0"/>

Digital Inputs 6 Available

<input checked="" type="checkbox"/> Digital Input 1 Name <input type="text" value="Remote Start Request (op)"/>	<input checked="" type="checkbox"/> Digital Input 2 Name <input type="text" value="Valve Limit Switch"/>	<input checked="" type="checkbox"/> Digital Input 3 Name <input type="text" value="Inlet Pressure Switch (opt)"/>
Purpose <input type="text" value="Remote start request from SCADA"/>	Purpose <input type="text" value="Limit switch indicated when valve close"/>	Purpose <input type="text" value="Indicates sufficient pressure reached"/>
<input checked="" type="checkbox"/> Digital Input 4 Name <input type="text" value="Manual Start Pump Req"/>	<input checked="" type="checkbox"/> Digital Input 5 Name <input type="text" value="Manual Stop Pump Req"/>	<input checked="" type="checkbox"/> Digital Input 6 Name <input type="text" value="Emergency Stop"/>
Purpose <input type="text" value="Local start pump button"/>	Purpose <input type="text" value="Local stop pump button"/>	Purpose <input type="text" value="Emergency stop button"/>

Analog Outputs (4-20mA) Note: Analog Outputs are sourced with controller power.

<input type="checkbox"/> Analog Output #1	Scaling
Name <input type="text"/> Units <input type="text"/>	4mA = <input type="text"/> 20mA = <input type="text"/> Decimal <input type="text"/>
<input type="checkbox"/> Analog Output #2	Scaling
Name <input type="text"/> Units <input type="text"/>	4mA = <input type="text"/> 20mA = <input type="text"/> Decimal <input type="text"/>
<input type="checkbox"/> Analog Output #3	Scaling
Name <input type="text"/> Units <input type="text"/>	4mA = <input type="text"/> 20mA = <input type="text"/> Decimal <input type="text"/>
<input type="checkbox"/> Analog Output #4	Scaling
Name <input type="text"/> Units <input type="text"/>	4mA = <input type="text"/> 20mA = <input type="text"/> Decimal <input type="text"/>

Solenoid Outputs

<input checked="" type="checkbox"/> *Solenoid Output #1 (SO1)	<input checked="" type="checkbox"/> Solenoid Output #2 (SO2)	Note: SO1 and SO2 are a powered solid state output typically reserved for solenoids used on a 131 or 133 series valve. The output can be configured as PWM (default) or Discrete ON/OFF. If configured as discrete, a value of 0 represents an open circuit, and 1 a closed circuit.
Name Closing Solenoid <small>Default: Closing Solenoid</small>	Name Opening Solenoid <small>Default: Opening Solenoid</small>	

Relay Output

<input checked="" type="checkbox"/> Relay Output #1 (RO1)	<input checked="" type="checkbox"/> Relay Output #2 (RO2)	Note: RO1 and RO2 are configured as dry contact mechanical relays typically used for alarms. These outputs are configured as Discrete ON/OFF, a value of 0 represents an open circuit, and 1 a closed circuit.
Name Pump Start Command	Name Alarm Output	

Actions/Alarms

<input type="checkbox"/> Action #1	Name <input type="text"/>	Describe <input type="text"/>
<small>Additional Comments</small> <input type="text"/>		
<input type="checkbox"/> Action #2	Name <input type="text"/>	Describe <input type="text"/>
<small>Additional Comments</small> <input type="text"/>		
<input type="checkbox"/> Action #3	Name <input type="text"/>	Describe <input type="text"/>
<small>Additional Comments</small> <input type="text"/>		
<input type="checkbox"/> Action #4	Name <input type="text"/>	Describe <input type="text"/>
<small>Additional Comments</small> <input type="text"/>		

Communication

<input type="checkbox"/> GSM/GPRS	<input checked="" type="checkbox"/> Modbus TCP/IP	<input type="checkbox"/> Modbus RTU (RS485/RS232)	Note: See ModBus specification page for register mapping and implementation. Refer to manual for more details.
-----------------------------------	---	---	---

***Control Logic** (Please specify all control logic using sketches, diagrams, etc. Attach additional sheets if necessary)


This app will control a 131 Series Pump Control Valve. Active control can be selected as Flow, Position, or Upstream Pressure.

Once a Start Command is received, either through the pushbutton or remotely, a command will be sent to start the pump. Once pressure has been reached, valve will begin to open and control selected process variable. For Flow or Position control, if the feedback is below the setpoint, the valve will modulate open. If the feedback is above the setpoint, the valve will modulate closed. For Upstream Pressure control, if the feedback is below the setpoint, the valve will modulate closed. If the feedback is above the setpoint, the valve will modulate open.

If the selected Process Variable (Flow, Position, or Upstream Press.) losses either of its inputs (Setpoint or Feedback), the valve will throw a fault and close.


* This is only to give an idea of where wires will be landed. Does not account for number of wires and Loop or Field powered. Please refer to **Electrical Wiring** section of VC-22D IOM for help wiring loop or field powered devices.

** This page for troubleshooting and reference only! Red text represents predefined I/O within the App. Controller wiring should not be changed in the field, but additional I/O can be landed at the DIN rail. To add functionality or use optional I/O for something else, contact your Cla-Val Rep.

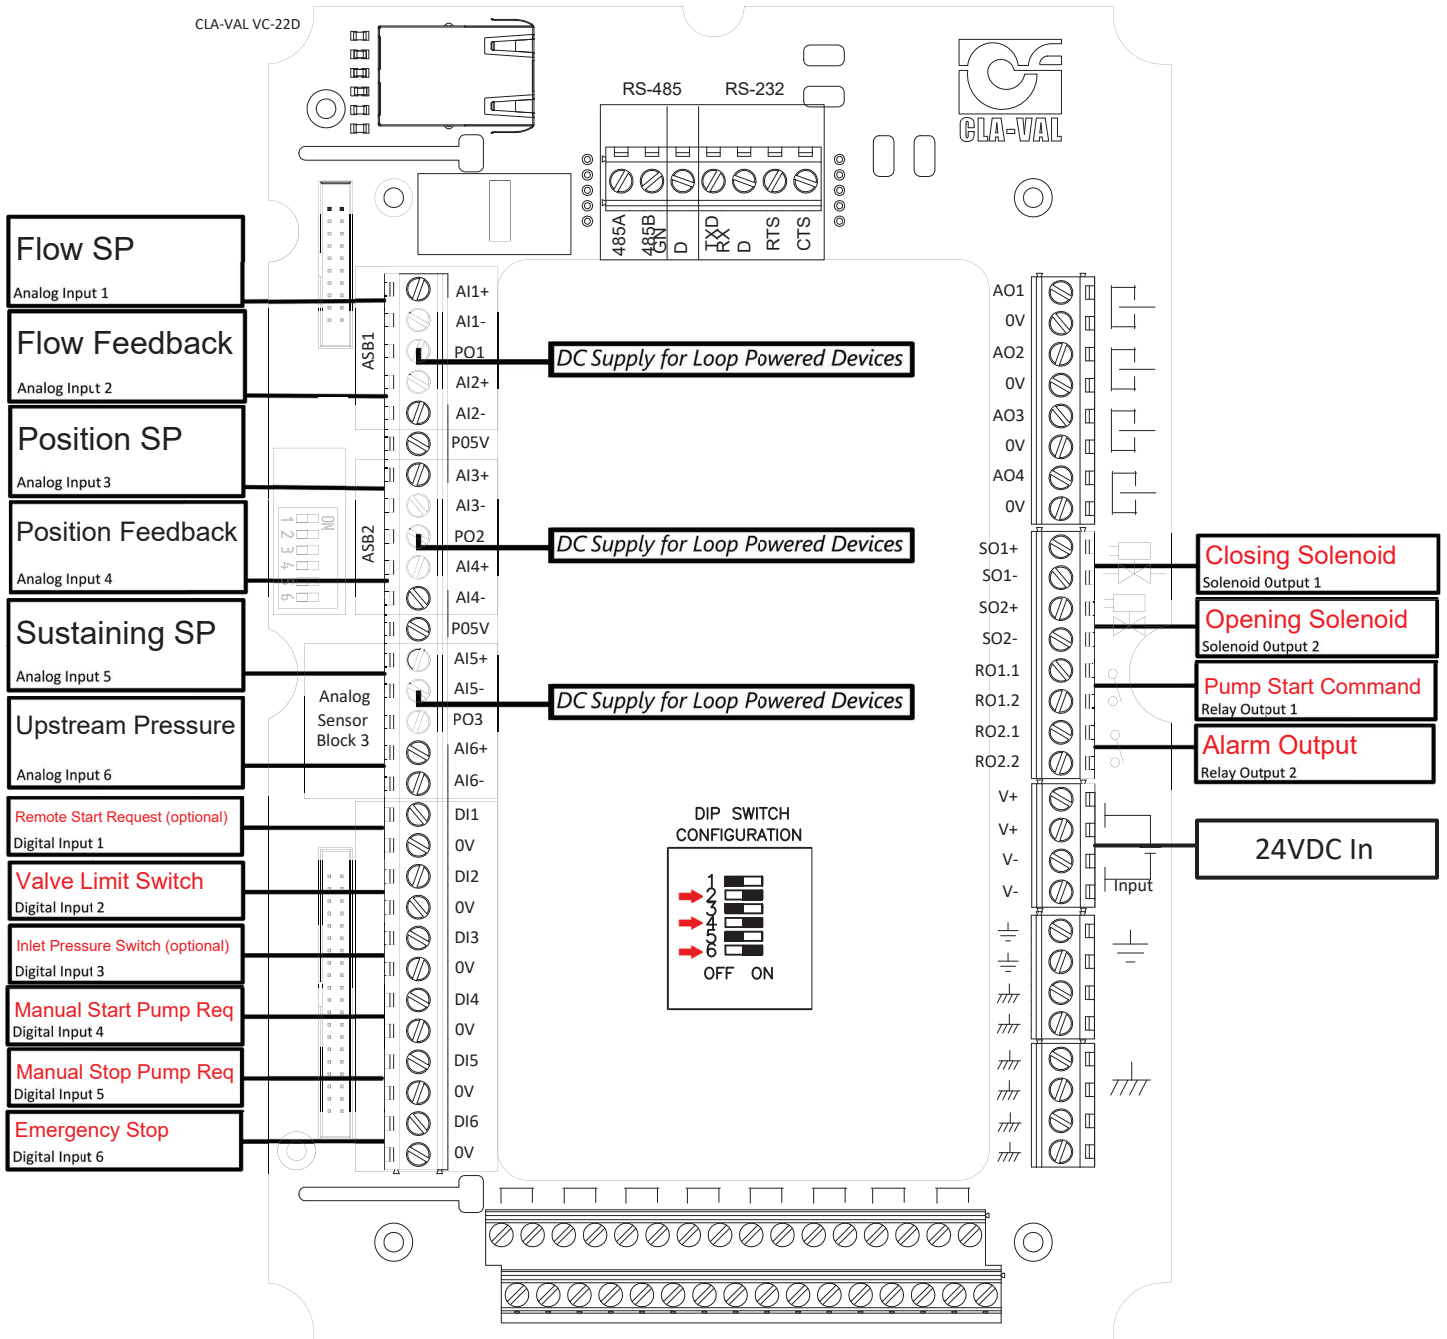

*Please refer to individual I/O sensor documents for correct wiring. This is only to give an idea of where wires will be landed. Does not account for number of wires and Loop or Field powered.

**Optional I/O does not need to be landed for App to function. To add functionality or additional I/O, contact Cla-Val rep.

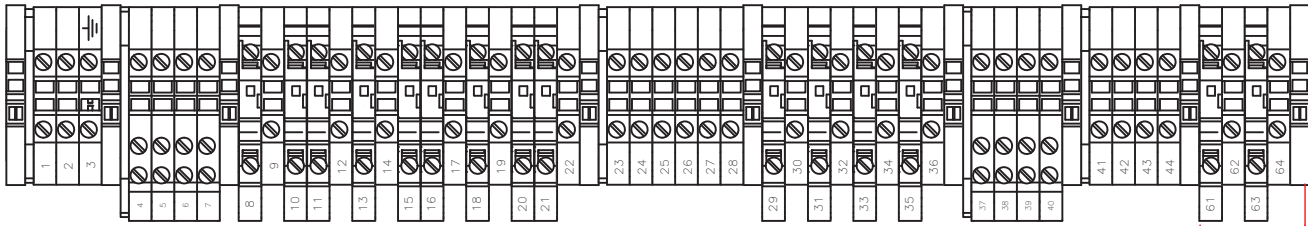

Only on panels manufactured after 9/30/2022

Land AC Solenoids here

CUSTOMER CONNECTIONS	
TERM	DESCRIPTION
POWER SUPPLY	
1 ; (L)	120 - 240 VAC/ 50 - 60 HZ
2 ; (N)	
3 ; GROUND	
SOLENOID OUTPUTS 120-240 VAC/50-60 HZ	
4 ; SO1+ (L)	Closing Solenoid
5 ; SO1- (N)	
6 ; SO2+ (L)	Opening Solenoid
7 ; SO2- (N)	
ANALOG INPUTS 4-20MA	
8 ; AI1+	Flow SP
9 ; AI1-	
10 ; PO1	DC Supply For Loop Powered Devices
11 ; AI2+	Flow Feedback
12 ; AI2-	
13 ; AI3+	Position SP
14 ; AI3-	
15 ; PO2	DC Supply For Loop Powered Devices
16 ; AI4+	Position Feedback
17 ; AI4-	
18 ; AI5+	Sustaining SP
19 ; AI5-	
20 ; PO3	DC Supply For Loop Powered Devices
21 ; AI6+	Upstream Pressure
22 ; AI6-	
DIGITAL INPUTS (USE WITH DRY CONTACT ONLY)	
23 ; DI1+	Remote Start Request (optional)
24 ; DI1-	

CUSTOMER CONNECTIONS	
TERM	DESCRIPTION
25 ; DI2+	Valve Limit Switch
26 ; DI2-	
27 ; DI3+	Inlet Pressure Switch (optional)
28 ; DI3-	
ANALOG OUTPUTS 4-20MA	
29 ; AO1+	Not used
30 ; AO1-	
31 ; AO2+	Not used
32 ; AO2-	
33 ; AO3+	Not used
34 ; AO3-	
35 ; AO4+	Not used
36 ; AO4-	
SOLENOID OUTPUTS 24 VDC	
37 ; SO1+ (24VDC)	Closing Solenoid
38 ; SO1- (0VDC)	
39 ; SO2+ (24VDC)	Opening Solenoid
40 ; SO2- (0VDC)	
DIGITAL OUTPUTS (OPEN/CLOSES DRY CONTACT)	
41 ; RO1.1	Pump Start Command
42 ; RO1.2	
43 ; RO2.1	Alarm Output
44 ; RO2.2	
SPARE 24 VDC OUTPUTS (on panels manufactured after 9/30/2022)	
61	24 VDC
62	0 VDC
63	24VDC
64	0 VDC

Land DC Solenoids here

Cla-Val VC-22D Modbus Addresses

Project Name:

N/A

Date:

Modbus	Input	Description	Data Type	Access	I/O Mapping	Comments
40007 Bit 0	Flow SP	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI1 Input to use Modbus Address 43000/43001
40007 Bit 1	Flow Feedback	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI2 Input to use Modbus Address 43002/43003
40007 Bit 2	Position SP	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI3 Input to use Modbus Address 43004/43005
40007 Bit 3	Position Feedback	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI4 Input to use Modbus Address 43006/43007
40007 Bit 4	Sustaining SP	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI5 Input to use Modbus Address 43008/43009
40007 Bit 5	Upstream Pressure	Analog Input Modbus Override	Bit	Write	N/A	Overrides 4-20mA AI6 Input to use Modbus Address 43010/43011
40008 Bit 0	Remote Start Request (optional)	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI1 Input to use Modbus Address 41000
40008 Bit 1	Valve Limit Switch	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI2 Input to use Modbus Address 41001
40008 Bit 2	Inlet Pressure Switch (optional)	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI3 Input to use Modbus Address 41002
40008 Bit 3	Manual Start Pump Req	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI4 Input to use Modbus Address 41003
40008 Bit 4	Manual Stop Pump Req	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI5 Input to use Modbus Address 41004
40008 Bit 5	Emergency Stop	Digital Input Modbus Override	Bit	Write	N/A	Overrides Hardwire DI6 Input to use Modbus Address 41005
41000	Remote Start Request (optional)	Digital Input	Word	Read/Write	DI1	Register Holds/Reads DI1 Value
41001	Valve Limit Switch	Digital Input	Word	Read/Write	DI2	Register Holds/Reads DI2 Value
41002	Inlet Pressure Switch (optional)	Digital Input	Word	Read/Write	DI3	Register Holds/Reads DI3 Value
41003	Manual Start Pump Req	Digital Input	Word	Read/Write	DI4	Register Holds/Reads DI4 Value
41004	Manual Stop Pump Req	Digital Input	Word	Read/Write	DI5	Register Holds/Reads DI5 Value
41005	Emergency Stop	Digital Input	Word	Read/Write	DI6	Register Holds/Reads DI6 Value
41006	Closing Solenoid	Digital Output	Word	Read	S01	Monitory Purposes (Optional)
41007	Opening Solenoid	Digital Output	Word	Read	S02	Monitory Purposes (Optional)
41008	Pump Start Command	Digital Output	Word	Read	R01	Monitory Purposes (Optional)
41009	Alarm Output	Digital Output	Word	Read	R02	Monitory Purposes (Optional)
43000/43001	Flow SP	Analog Input	Int 32	Read/Write	AI1	Register Holds/Reads AI1 Value x100 for Two Implied Decimals
43002/43003	Flow Feedback	Analog Input	Int 32	Read/Write	AI2	Register Holds/Reads AI2 Value x100 for Two Implied Decimals
43004/43005	Position SP	Analog Input	Int 32	Read/Write	AI3	Register Holds/Reads AI3 Value x100 for Two Implied Decimals
43006/43007	Position Feedback	Analog Input	Int 32	Read/Write	AI4	Register Holds/Reads AI4 Value x100 for Two Implied Decimals
43008/43009	Sustaining SP	Analog Input	Int 32	Read/Write	AI5	Register Holds/Reads AI5 Value x100 for Two Implied Decimals
43010/43011	Upstream Pressure	Analog Input	Int 32	Read/Write	AI6	Register Holds/Reads AI6 Value x100 for Two Implied Decimals
43036/43037	--	Analog Output	Int 32	Read	AO1	Monitory Purposes (Optional) - Register Holds AO1 Value x100 for Two Implied Decimals
43038/43039	--	Analog Output	Int 32	Read	AO2	Monitory Purposes (Optional) - Register Holds AO2 Value x100 for Two Implied Decimals
43040/43041	--	Analog Output	Int 32	Read	AO3	Monitory Purposes (Optional) - Register Holds AO3 Value x100 for Two Implied Decimals
43042/43043	--	Analog Output	Int 32	Read	AO4	Monitory Purposes (Optional) - Register Holds AO4 Value x100 for Two Implied Decimals

***Additional ModBus information can be found in the manual.