

Hytrol Valve




- Drip-Tight, Positive Seating
- Service Without Removal From Line
- Threaded, Flanged or Grooved Ends
- Globe or Angle Pattern
- 100% Factory Tested

The Cla-Val Model 100-01 Hytrol Valve is a hydraulically operated, diaphragm actuated, globe or angle pattern valve. It consists of three major components: body, diaphragm assembly, and cover. The diaphragm assembly is the only moving part.

The diaphragm assembly is guided top and bottom by a precision machined stem. It utilizes a non-wicking diaphragm of nylon fabric bonded with synthetic rubber. A resilient synthetic rubber disc retained on three and one half sides by a disc retainer forms a drip-tight seal with the renewable seat when pressure is applied above the diaphragm.


The Model 100-01 is the basic valve used in nearly all Cla-Val Automatic Control Valves. It is the valve of choice for system applications requiring remote control, pressure regulation, solenoid operation, rate of flow control, liquid level control or check valve operation. The rugged simplicity of design and packless construction assure a long life of dependable, trouble-free operation. It is available in various materials and in a full range of sizes, with either threaded, flanged or grooved ends. Its applications are unlimited.

Principle of Operation




Full Open Operation

When pressure in the cover chamber is relieved to a zone of lower pressure, the line pressure at the valve inlet opens the valve, allowing full flow.



Tight Closing Operation

When pressure from the valve inlet is applied to the cover chamber, the valve closes drip-tight.



Modulating Action

The valve holds any intermediate position when operating pressures are equal above and below the diaphragm. A Cla-Val "Modulating" Pilot Control will allow the valve to automatically compensate for line pressure changes.

Specifications Model 100-01

Available Sizes

Pattern	Threaded	Flanged	Grooved End
Globe	%" - 3"	1½" - 36"	1½"-2"- 2½"- 3"- 4"- 6"- 8"
Angle	1" - 3"	1½" - 16" & 24"	1½"-2"- 2½"- 3"- 4"- 6"

Fluids											
-40° to	180°	F									

Operating Temp. Range

Pressure Ratings (Recommended Maximum Pressure - psi)

Value Rody 8	Cover	Pressure Class										
Valve Body 8	Cover	Fla	anged	Grooved	Threaded							
Grade	Material	ANSI Standards*	150 Class	300 Class	300 Class	End‡ Details						
ASTM A536	Ductile Iron	B16.42	250	400	400	400						
ASTM A216-WCB	Cast Steel	B16.5	285	400	400	400						
UNS 87850	Bronze	B16.24	225	400	400	400						

Note: * ANSI standards are for flange dimensions only.

Flanged valves are available faced but not drilled.

‡ End Details machined to ANSI B2.1 specifications.

Valves for higher pressure are available; consult factory for details

Materials

Component	Standard Material Combinations							
Body & Cover	Ductile Iron	Cast Steel	Bronze					
Disc Retainer & Diaphragm Washer	Cast Iron	Cast Steel	Bronze					
Trim: Disc Guide, Seat & Cover Bearing	Bronze is Standard Stainless Steel is optional							
Disc		Buna-N® Rubber						
Diaphragm	Nylon Reinforced Buna-N® Rubber							
Stem, Nut & Spring	Stainless Steel							

For material options not listed, consult factory. Cla-Val manufactures valves in more than 50 different alloys.

Viton® Rubber Parts - suffix KB

Optional diaphragm, disc and o-ring fabricated with Viton® synthetic rubber. Viton® is well suited for use with mineral acids, salt solutions, chlorinated hydrocarbons, and petroleum oils; and is primarily used in high temperature applications up to 250° F. Do not use with epoxy coatings above 175° F.

Epoxy Coating - suffix KC


The NSF/ANSI 61 fusion bonded epoxy coating option is for use with cast iron, ductile iron or steel valves. This coating is resistant to various water conditions, certain acids, chemicals, solvents and alkalies. epoxy coatings are applied in accordance with AWWA coating specifications C116-03. Do not use with temperatures above 175° F.

Dura-Kleen® Stem - suffix KD

This stem is designed for applications where water supplies containing dissolved minerals create deposits that build-up on a standard stem and hamper valve operation. A patented, self-cleaning design on the stem allows all valve sizes to operate freely in the harshest conditions.

Delrin® Sleeved Stem - suffix KG

The Delrin® sleeved stem is designed for applications where water supplies contain dissolved minerals which can form deposits that build up on the valve stem and hamper valve operation. Scale build-up will not adhere to the Delrin® sleeve stem. Delrin® sleeved stems are not recommended for valves in continuous operation where differential pressures are in excess of 80 psi (2" and larger Hytrol valves).

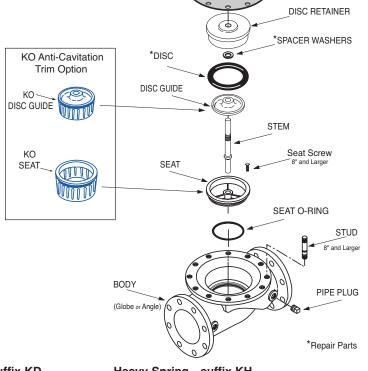

COVER

SPRING

Cover Bolt I

*DIAPHRAGM

PIPE PLUG

COVER BEARING

DIAPHRAGM WASHER

STEM NUT

HEX NUT

8" and Larger

Heavy Spring - suffix KH

The heavy spring option is used in applications where there is low differential pressure across the valve, and the additional spring force is needed to help the valve close. This option is best suited for valves used in on-off (non-modulating) service.

Anti-Cavitation Trim - suffix KO

Anti-Cavitation Trim components consist of a stainless steel radial slotted disc guide and seat. This system is used when high differentials are present across the valve.

Water Treatment Clearance - suffix KW

This additional clearance is beneficial in applications where water treatment compounds can interfere with the closing of the valve. The smaller outside diameter disc guide provides more clearance between the disc guide and the valve seat. This option is best suited for valves used in on-off (non-modulating) service.

For assistance in selecting appropriate valve options or valves manufactured with special design requirements, please contact our Regional Sales Office or Factory.

Functional Data † Non Guided Stem Model 100-0													0-01											
Value	0:	Inches	_% †	½†	¾ †	1†	1	11/4	1½	2	2½	3	4	6	8	10	12	14	16	18	20	24	30	36
Valve	Size	mm.	10	15	20	25	25	32	40	50	65	80	100	150	200	250	300	350	400	450	500	600	750	900
	Globe	Gal./Min.(gpm)	1.8	6	8.5	13.3	20	30	32	54	85	115	200	440	770	1245	1725	2300	3130	4450	5345	7655	10150	14020
CV	Angle	Gal./Min.(gpm)	_	_	_	_	21	27	29	61	101	139	240	541	990	1575	2500*	3190*	4200*	_	_	9950*	_	_
C 1/2	Globe	Litres/Sec. (I/s)	.43	1.44	2.04	3.2	4.8	7.2	7.7	13	20	28	48	106	185	299	414	553	752	1069	1284	1839	2439	3369
C _V _l/s	Angle	Litres/Sec. (I/s)	-	_	-	_	5.0	6.5	7.0	14.7	24	33	58	130	238	378	601	766	1009	_	_	2391	_	_
Equivalent	Globe	Feet (ft)	22	7	15	22	10	18	36	47	48	81	111	195	267	333	432	397	429	392	477	606	1168	1610
Length	Globe	Meters (m)	6.8	2.1	4.6	6.7	2.9	5.5	11	14	15	25	34	60	81	102	132	121	131	119	145	185	356	491
of	Angle	Feet (ft)	_	_	_	_	9	22	44	37	34	56	77	129	161	208	205	206	239	_	_	359	_	_
Pipe	Aligie	Meters (m)	-	_	_	_	2.7	6.8	13	11	10	17	24	39	49	63	63	63	73	_	_	109	_	_
K	GI	obe Pattern	16.3	3.7	5.7	6.1	2.7	3.6	5.9	5.6	4.6	6.0	5.9	6.2	6.1	5.8	6.1	5.0	4.6	3.7	3.9	4.0	5.8	6.4
Factor	Ar	ngle Pattern	-	-	-	_	2.5	4.4	7.1	4.4	3.3	4.1	4.1	4.1	3.7	3.6	2.9	2.6	2.6	_	_	2.4	_	_
Lieudal Die		Fl. Oz	.12	.34	.34	.70	_	_	_	-	_	-	_	_	_	_	_	_	_	_	_	_	_	_
Liquid Dis from Co		U.S. Gal.	-	_	-	_	.02	.02	.02	.03	.04	.08	.17	.53	1.26	2.51	4.0	6.5	9.6	11	12	29	42	90
Chamber		ml	3.5	10.1	10.1	20.7	75.7	75.7	75.7	121	163	303	643	_	_	_	_	_	_	_	_	_	_	_
Valve Opens	helis	Litres	_	_	_		_	_	_	_	_	_	_	2.0	4.8	9.5	15.1	24.6	36.2	41.6	45.4	109.8	159	340

C_V Factor

Formulas for computing C_V Factor, Flow (Q) and Pressure Drop (\blacktriangle P):

$$C_V = \frac{Q}{\sqrt{\triangle P}}$$
 $Q = C_V \sqrt{\triangle P}$ $\triangle P = \left(\frac{Q}{C_V}\right)^2$

K Factor (Resistance Coefficient)

The Value of K is calculated from the formula: $K = \frac{894d^4}{Cv^2}$ (U.S. system units)

Equivalent Length of Pipe

Equivalent lengths of pipe (L) are determined from the formula: L = Kd 12 f (U.S. system units)

Fluid Velocity

Fluid velocity can be calculated from the following formula: $V = \frac{.4085 \text{ Q}}{d^2}$ (U.S. system units)

 $\mathbf{C}_{\mathbf{V}} = \text{U.S. (gpm)} @ 1 \text{ psi differential at } 60^{\circ} \text{ F water}$

 C_{V-} I/s = (I/s) @ 1 bar (14.5 PSIG) differential at 15 $^{\circ}$ C water

d = inside pipe diameter of Schedule 40 Steel Pipe (inches)

*Estimated

f = friction factor for clean, new Schedule 40 pipe (dimensionless) (from Cameron Hydraulic Data, 18th Edition, P 3-119)

K = Resistance Coefficient (calculated)


L = Equivalent Length of Pipe (feet)

Q = Flow Rate in U.S. (gpm) or (l/s)

V = Fluid Velocity (feet per second) or (meters per second)


 $\triangle \mathbf{P}$ = Pressure Drop in (psi) or (bar)


Model 100-01 Flow Chart (Based on normal flow through a wide open valve)

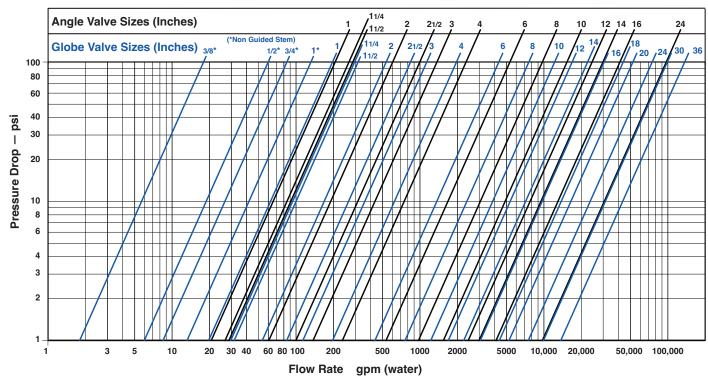



Dimensions

3/8", 1/2", 3/4", 1" Auxillary Hytrol Valves with non Guided Stems









up to 16"

18" & Larger

Value Cine (In alt an)	3/-+	1/-+	3/4*	1*	4	1 1/4	41/-	•	0.1/-	_	4	•	•	40	40	44	40	40±	20+	0.4+	20+	200
Valve Size (Inches)	3/8*	1/2*	, .		7.05	. , .	1 1/2	2	21/2	3	4	6	8	10	12	14	16	18 [†]	20 [†]	24 [†]	30 [†]	36†
A Threaded	2.75	3.50	3.50	5.12	7.25	7.25	7.25	9.38	11.00	12.50	_	_			_		_	_	_		_	
AA 150 ANSI	_		_	_	_	_	8.50	9.38	11.00	12.00	15.00	20.00	25.38	29.75	34.00	39.00	41.38	46.00	52.00	61.50	63.00	72.75
AAA 300 ANSI	_	_	_	_	_	_	9.00	10.00	11.62	13.25	15.62	21.00	26.38	31.12	35.50	40.50	43.50	47.64	53.62	63.24	64.50	74.75
AAAA Grooved End	_	_	_	_	_	_	8.50	9.00	11.00	12.50	15.00	20.00	25.38	_	_	_	_	_	_	_	_	_
B Diameter	2.50	3.12	3.12	4.38	5.62	5.62	5.62	6.62	8.00	9.12	11.50	15.75	20.00	23.62	28.00	32.75	35.50	41.50	45.00	53.16	56.00	66.00
C Maximum	2.33	5.88	5.88	6.25	5.50	5.50	5.50	6.50	7.56	8.19	10.62	13.38	16.00	17.12	20.88	24.19	25.00	39.06	42.27	45.00	54.73	59.00
CC Maximum Grooved End	_	_	_	_	_	_	4.75	5.75	6.88	7.25	9.31	12.12	14.62	_	_	_	_	_	_	_	_	_
D Threaded	_	_	_	_	3.25	3.25	3.25	4.75	5.50	6.25	_	_	_	_	_	_	_	_	_	_	_	_
DD 150 ANSI	_	_	_	_	_	_	4.00	4.75	5.50	6.00	7.50	10.00	12.69	14.88	17.00	19.50	20.81	_	_	30.75	_	_
DDD 300 ANSI	_	_	_	_	_	_	4.25	5.00	5.88	6.38	7.88	10.50	13.25	15.56	17.75	20.25	21.62	_	_	31.62	_	_
DDDD Grooved End	_	_	_	_	_	_	_	4.75	_	6.00	7.50	_	_	_	_	_	_	_	_	_	_	_
E Bottom of Valve	1.25	0.71	0.71	0.88	1.12	1.12	1.12	1.50	1.69	2.06	3.19	4.31	5.31	9.25	10.75	12.62	15.50	12.95	15.00	17.75	21.31	24.56
EE Grooved End	_	_	_	_	_	_	2.00	2.50	2.88	3.12	4.25	6.00	7.56	_	_	_	_	_	_	_	_	_
F 150 ANSI	_	_	_	_		—	2.50	3.00	3.50	3.75	4.50	5.50	6.75	8.00	10.75	12.63	15.50	15.00	16.50	19.25	22.50	28.50
FF 300 ANSI	_	_	_	_	_	<u> </u>	3.06	3.25	3.75	4.13	5.00	6.25	7.50	8.75	10.25	11.50	12.75	15.00	16.50	19.25	24.00	30.00
G Threaded	_	_	_	_	1.88	1.88	1.88	3.25	4.00	4.50	_	_	_	_	_	_	_	_	_	_	_	_
GG 150 ANSI	_	—	_	_	_	_	4.00	3.25	4.00	4.00	5.00	6.00	8.00	8.62	13.75	14.88	15.69	_	_	22.06	—	_
GGG 300 ANSI	_	_	_	_	_	_	4.25	3.50	4.31	4.38	5.31	6.50	8.50	9.31	14.50	15.62	16.50	_	_	22.90	_	_
GGGG Grooved End	_	_	_	_	_	_	_	3.25	_	4.25	5.00	_	_	_	_	_	_	_	_	_	—	_
H NPT Body Tapping	<u> </u>	0.125	0.125	0.25	0.375	0.375	0.375	0.375	0.50	0.50	0.75	0.75	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	2.00	2.00
J NPT Cover Center Plug	0.125	0.125	0.125	0.25	0.25	0.25	0.25	0.50	0.50	0.50	0.75	0.75	1.00	1.00	1.25	1.50	2.00	1.00	1.00	1.00	2.00	2.00
K NPT Cover Tapping	<u> </u>	0.125	0.125	0.25	0.375	0.375	0.375	0.375	0.50	0.50	0.75	0.75	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	2.00	2.00
Valve Stem Int. Thread UNF	_	_	_	_	10-32	10-32	10-32	10-32	10-32	1/4-28	1/4-28	3/8-24	3/8-24	3/8-24	3/8-24	3/8-24	1/2-20	3/4-16	3/4-16	3/4-16	3/4-16	3/4-16
Stem Travel	_	_	_	_	0.40	0.40	0.40	0.60	0.70	0.80	1.10	1.70	2.30	2.80	3.40	4.00	4.50	5.10	5.63	6.75	7.50	8.50
Approx. Ship Weight (lbs)	3	3	8	8	15	15	15	35	50	70	140	285	500	780	1165	1600	2265	2982	3900	6200	7703	11720

^{*}Non Guided Stem Auxiliary Hytrol Controls

Cla-Val Control Valves operate with maximum efficiency when mounted in horizontal piping with the main valve cover UP, however, other positions are acceptable. Due to component size and weight of 8 inch and larger valves, installation with cover UP is advisable. We recommend isolation valves be installed on inlet and outlet for maintenance. Adequate space above and around the valve for service personnel should be considered essential. A regular maintenance program should be established based on the specific application data. However, we recommend a thorough inspection be done at least once a year. Consult factory for specific recommendations.



go to www.cla-val.com and click on the YouTube link to view a 3D animation demonstrating how the 100-01 operates

^{†18} inch and larger 100-01 series Hytrol valves are equipped with flange feet for safety and convenience. Consult Cla-Val representative for details.